


Through Roof Assembly

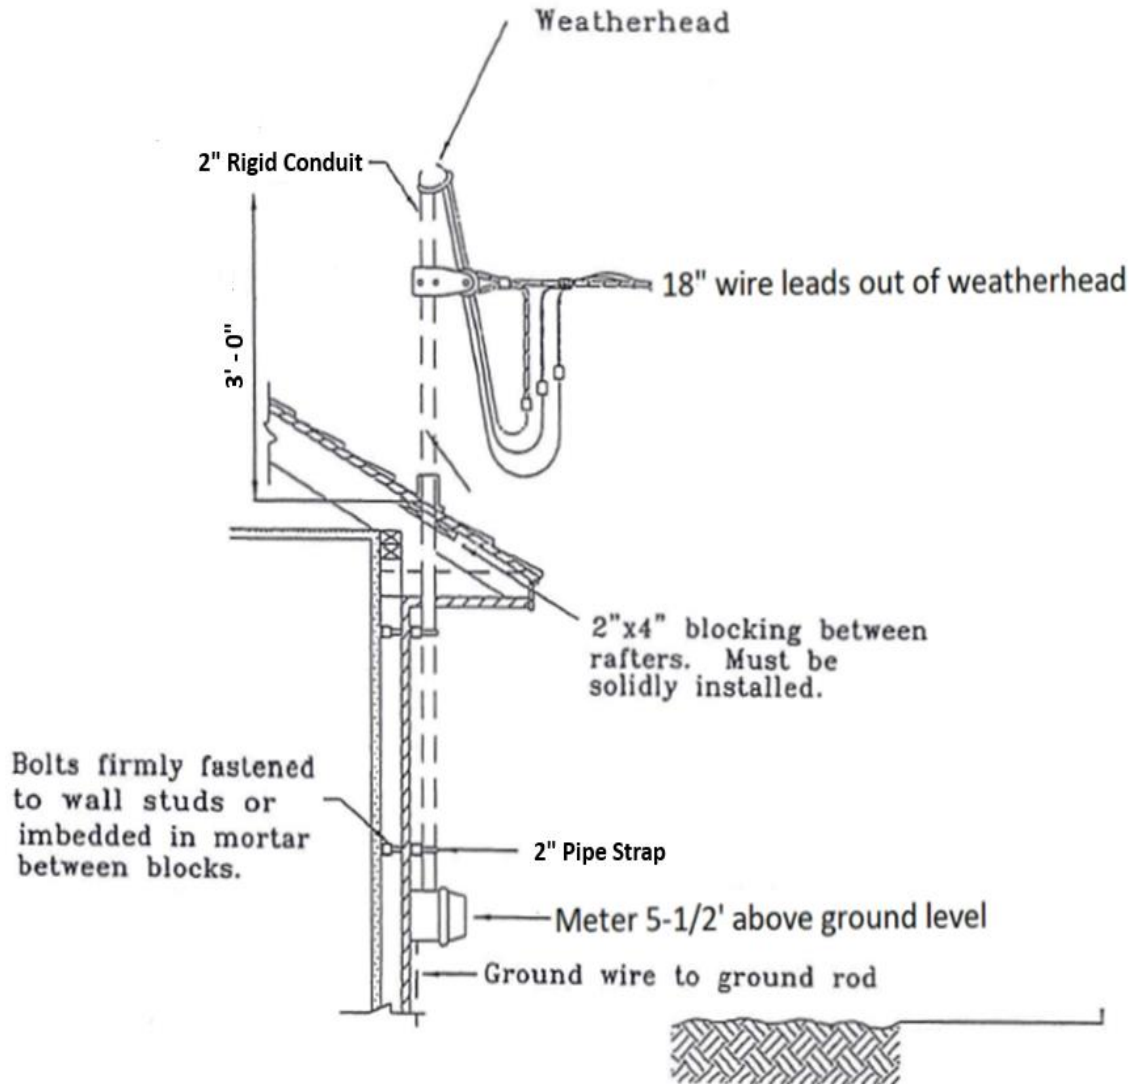

Notes:

1. BEA engineering staff must spot meter base location prior to meter base installation.
2. If length of conduit exceeds 10 feet, coupling must be below roof line.
3. Anchor required should must exceed 3' above roof.
4. Intersystem bonding termination strip required on all residential services.
5. The through roof assembly must pass a State of Tennessee electrical inspection prior to BEA service connection.